



GENERAL CONNECTION FOR "ORBIS" COMBINED SMOKE AND HEAT DETECTOR UNITS

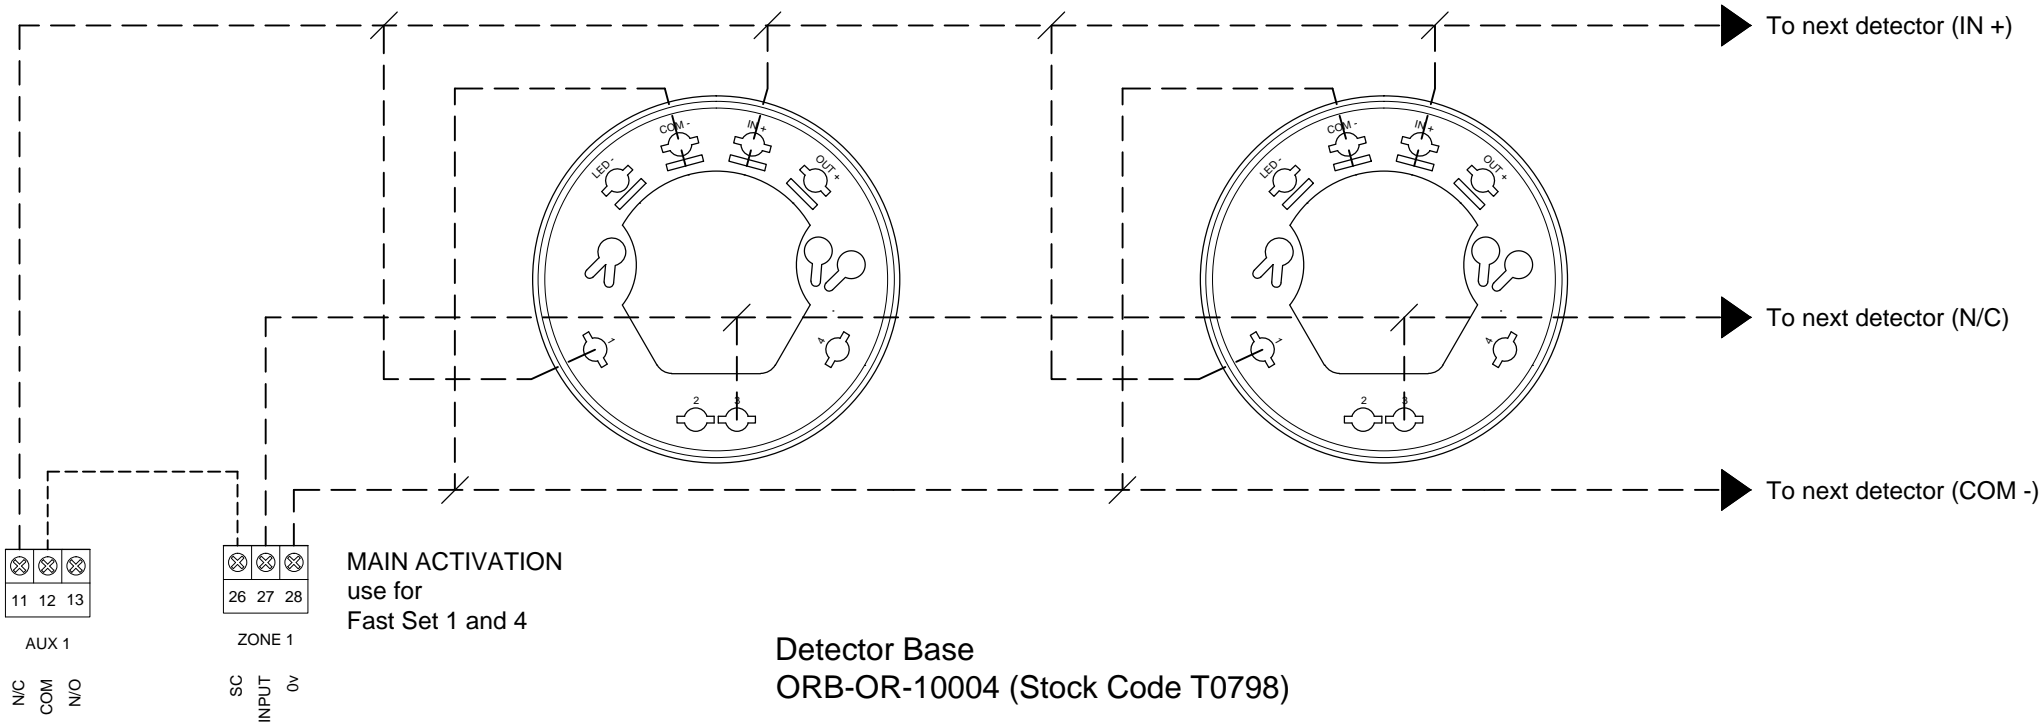


MAIN ACTIVATION
use for
Fast Set 1 and 4

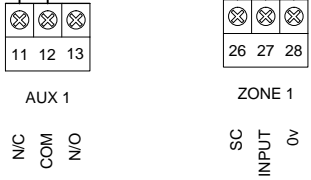

Detector Base
ORB-OR-10004 (Stock Code T0798)

Combined smoke/heat Detector
ORB-OH-13001 (Stock Code T0408)

LOCAL ACTIVATION
use for Fast Set 5

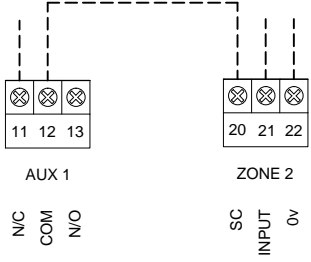

<i>Title</i>		
CONNECTION OF ORBIS COMBINED SMOKE/HEAT DETECTOR TO FDCCP 03		

<i>Date</i>	01/08/2021	
-------------	------------	--

<i>Drawn by</i>	DE	
-----------------	----	--

<i>Chk'd by</i>	AP	
-----------------	----	--

<i>Drq #</i>	FDCCP03 To ORBIS Combined smoke heat detector	
--------------	---	--

ELLARD
 Roundthorne Industrial Estate
 Ellard House, Floats Road
 Wythenshawe, Manchester
 M23 9WB
 Tel: 0161 945 4561, e-mail: technical@ellard.co.uk